


10000 pF (0.01 μ F)
plate 8120

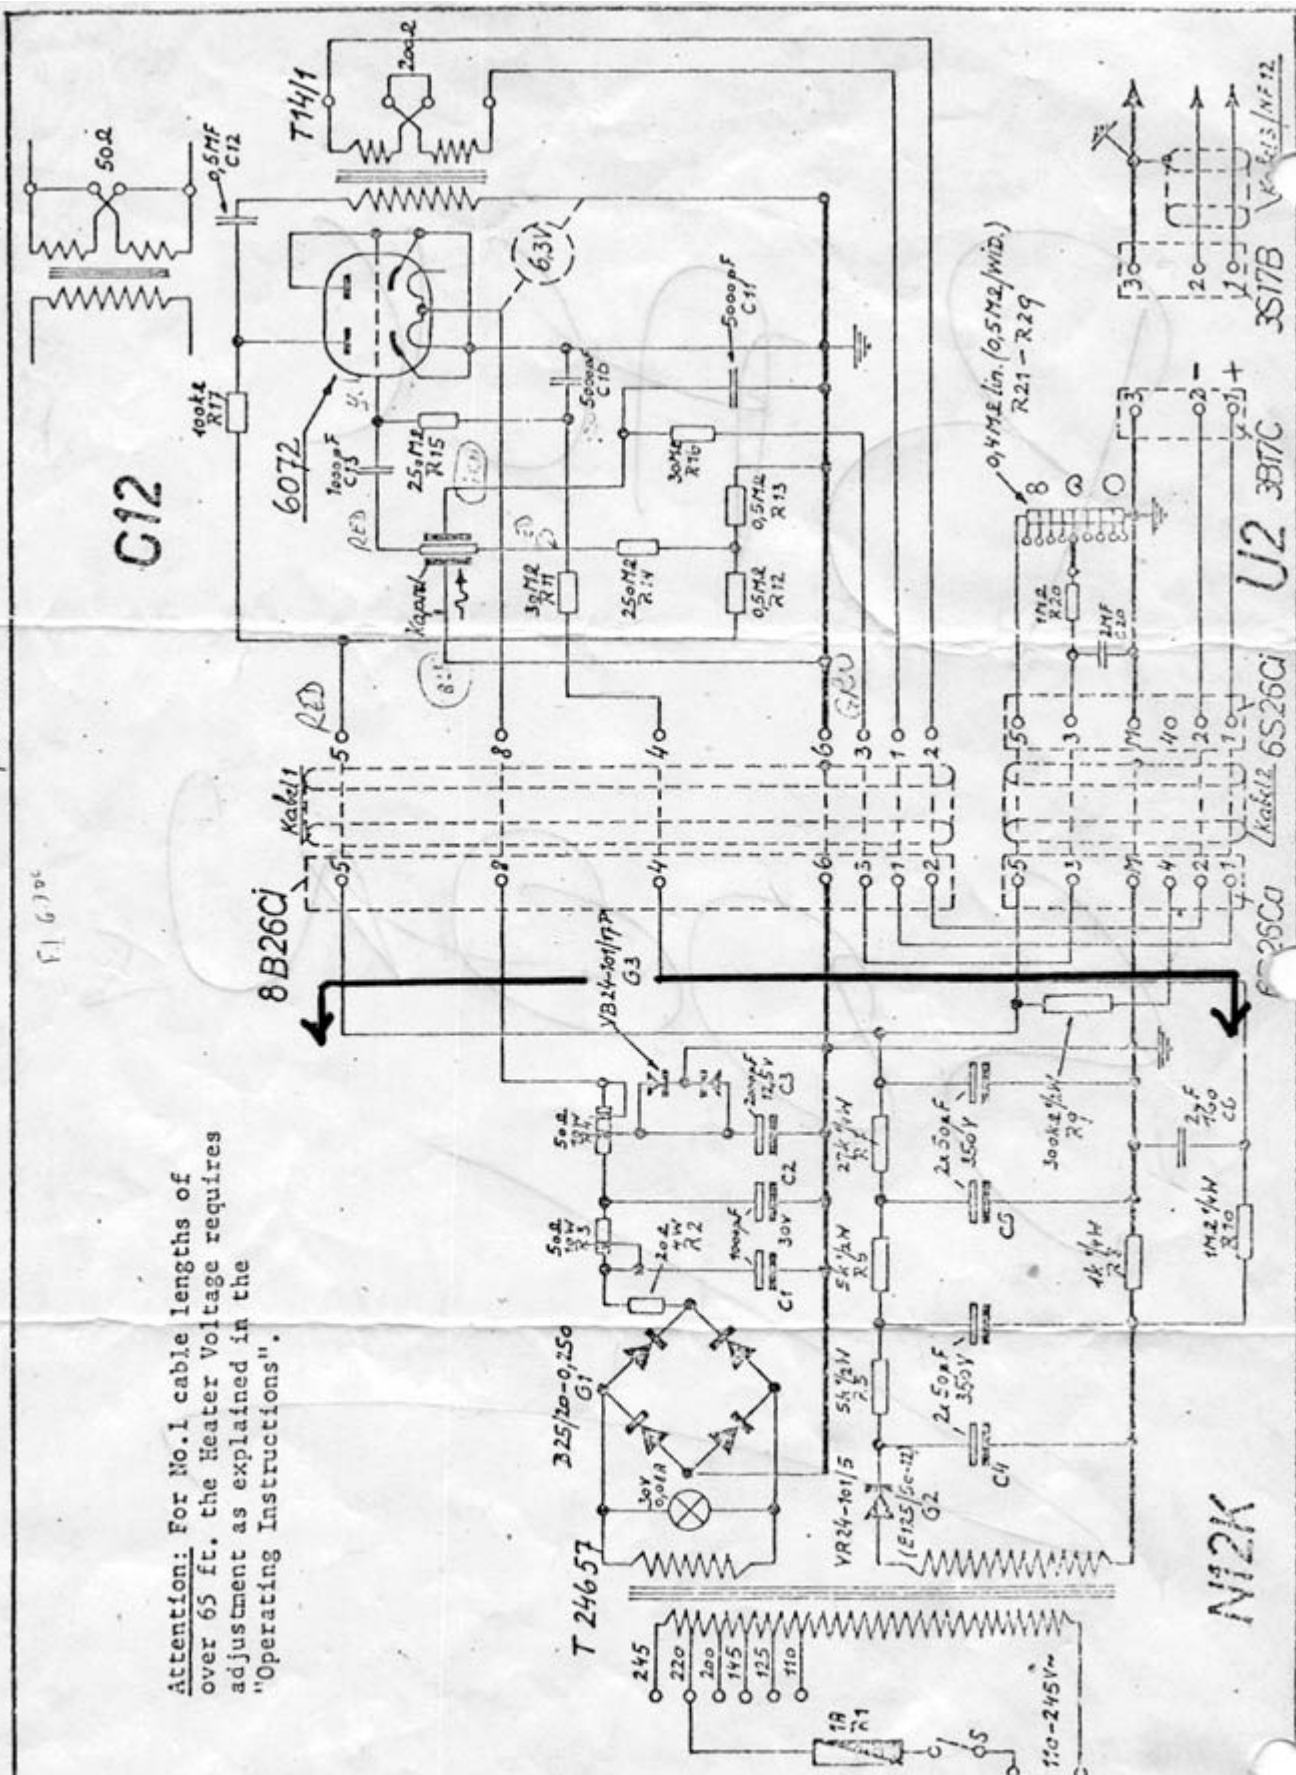

Attention: For No.1 cable lengths of over 65 ft. the Heater Voltage requires adjustment as explained in the "Operating Instructions".

Ersetzt für: 1331/D	Gezeichnet	11.3.1957	distab
Ersetzt durch:	Geprüft	11.3.57	W. ruy
C-12 + Power Supply C12		Z.-Nr. 12315ch	

A. K. G.